Fire Pump Controller



For Electric Motor Driven Fire Pumps





Across The Line Type

Series MP300 - Combined Manual and Automatic

Metron Fire Pump Controllers conform to the latest requirements of Chapter 10, National Fire Protection Association Pamphlet 20, Standard for Centrifugal Fire Pumps as adopted by Underwriters Laboratories and Factory Mutual. They are withstand rated and listed by Underwriters' Laboratories and approved by Factory Mutual Research Corporation.

Sizes range from 15 to 600 horsepower, 200 to 600 volts, 60 Hz. These controllers are for use on Across-the-Line type installations.

Only the highest quality components, all UL listed or UL recognized, are used throughout to assure the best possible reliability. The cabinet is fabricated of heavy gauge reinforced steel with drip-proof hood. All field wiring and service connections may be made from the front, allowing the controller to be mounted flush against a wall.

The controller is completely wired, assembled, and tested at the factory before shipment, and ready for immediate installation.





Standard Features

Operator Interface Device (OID) with LED Annunciator and Digital Display

POWER ON PHASE REVERSAL SYSTEM FAULT		TRANSFER SW IN NORMAL TRANSFER SW IN EMERG EMERG ISO SWITCH OPEN		
1 pose	SYSTEM	STAT	US	
PRES 101	60	BC	4800	
PSI	PSI	AC	4750	
	2	3	-	_
SYSTEM STATUS LOGS	CONFIG	PRINT	CHANGE /ENTER	
		RESET/	SILENCE	-
AUTO MANUAL	TEST	ESC ESC	/LAMP TEST	

- NEMA Type 2 drip proof metal freestanding enclosure
- AUTO, OFF, MANUAL selector switch illuminated on OID with colored LED's for controller mode operation
- Operator Interface Device (OID) with 4 lines by 20 character display with large character backlit Liquid Crystal Display (LCD) capable of being read in both direct sunlight or dark lighting conditions
- 10 pushbuttons for easy screen navigation, LED lamp test, alarm reset, controller test and horn silencing
- Removable labels to allow for easy field language changes
- All controller settings are programmable through the OID. All features are enabled or disabled through the OID, no jumpers or external wires are needed allowing easy field modification
- The system status data is displayed on the OID. The displayed items include: System pressure, Phase to Phase (AB, BC, AC) voltage, Phase current (A, B, C), Current time and date, System Events and Notifications such as Remote Start, Local Start etc., Number of starts, Total motor run

hours, Time remaining on sequential motor start and motor stop timers.

- Auxiliary alarm functions displayed on the OID LCD screen
- Audible horn with silence feature for silencable alarms
- Lamp test feature
- Foreign languages selectable through the OID
- Microprocessor based logic with real time/date clock capable of running a minimum of 14 days without AC power connected to controller
- SD Memory card used to record pressure log, event and log, and auxiliary user programs. Pressure log is stored in separate comma delimited ASCII text files with each file containing data for one day. The SD card is removable and can be read by any PC equipped with an SD card reader.
- Input and output status LED's provide visual indication of each discrete input's or output's on/off status
- One RS485 Serial Port

Auxiliary alarms:

The controller includes as standard six (6) discrete auxiliary inputs, nine (9) form 'C' auxiliary relay outputs. These auxiliary inputs and outputs are in addition to those mandated by NFPA 20. All auxiliary inputs, outputs, and OID Display can be field programmed through the OID.

Nine (9) of the following auxiliary alarms can be programmed and recorded in the event/alarm logs and annunciated on the OID display screen and/or output relay contact(s). These alarm conditions include:

LOW PUMP ROOM TEMP RESERVOIR LOW RESERVOIR EMPTY RESERVOIR HIGH FLOW METER ON RELIEF VALVE OPEN LOW SUCTION PRESSURE HIGH PUMP ROOM TEMPERATURE LOW FIREWATER PRESSURE LOW PURGE PRESSURE LOW GEAR OIL PRESSURE HIGH GEAR OIL TEMPERATURE



GAS DETECTION HIGH VIBRATION EMERGENCY POWER ON PUMP ROOM DOOR OPEN

Data logging:

The controller includes two (2) separate data logs for storing system data that is readable through the OID or copied to a computer equipped with an SD card reader. The 2 data logs are as follows:

Pressure Log: The pressure log provides a continuous pressure record for 30 days. The pressure log samples shall be time and date stamped and stored in permanent non-volatile SD memory card. The pressure log can be searched by each sample, by minute, or by hour through the OID.

Event Log: The event log will store up to 300 of the most current events. These events can include, but is not limited to, any of the following events/alarms:

PUMP RUNNING POWER AVAILABLE PHASE REVERSAL MOTOR OVERLOAD **REMOTE START** LOCAL START PUMP ON DEMAND SYSTEM FAULT AUTO MODE MANUAL MODE OFF MODE PRESSURE TRANSDUCER FAULT PUMP FAILED TO START LOW INTAKE SHUTDOWN ALARM SUPERVISORY POWER FAILURE LOW PRESSURE AUTO WEEKLY TEST START UNDER FREQUENCY OVER FREQUENCY LOW ZONE / HIGH ZONE CONTACTS HIGH DISCHARGE PRESSURE NO LOAD CONDITION

Options

Option H: Space Heater

If the ambient atmosphere is especially damp, a space heater rated at 100 watts may be supplied to reduce moisture in the cabinet. A thermostat is supplied as standard with this option. A humidistat may be substituted if specified.

Option T: Weekly Test Start Solenoid


In some cases it may be desirable to have the electric motor run at a preset time each week for approximately 30 minutes. The controller includes a built in weekly test function. This option complements the standard function by simulating a loss of pressure. Simulation of pressure loss is accomplished by opening a solenoid valve, which reduces the system pressure below the starting pressure of the controller.

Option W: Omit Legs

For systems where the controller is mounted on a common skid with the pump and motor, the legs of the controller may be omitted, 3" (76.2mm) channels or wall mounting brackets can be supplied. If specified, lifting eyes may also be supplied.

Enclosure

The following NEMA type enclosures are also available: 3R, 4, 4X (Painted Cold Rolled Steel), 4X (Unpainted 304 or 316 Stainless Steel), and 12

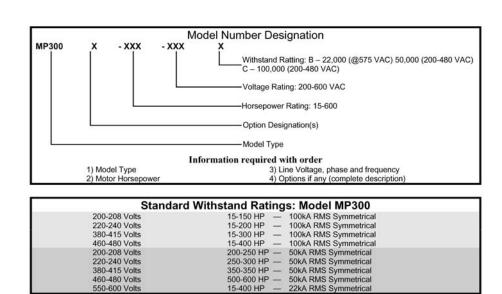

Fire Pump Controller



For Electric Motor Driven Fire Pumps

Model MP300 Across-the-line Start Microprocessor Electric Motor Fire Pump Controller

Specifications

General Controller Description

The Fire Pump Controller shall be factory assembled, wired and tested as a unit and shall conform to all requirements of the latest edition of NFPA 20, NFPA 70 and be Third Party Listed by Underwriters Laboratories (UL) and Approved by Factory Mutual (FM). The controller shall be available for 208, 230, 380-415, or 480 volt three phase power.

Controller Equipment Features

The controller shall include the following standard features:

- NEMA Type 2 drip proof metal freestanding enclosure
- AUTO, OFF, MANUAL, selector switch with colored LED's for controller mode condition
- Operator Interface Device (OID) with 4 lines by 20 character display with large character backlit LCD capable of being read in both direct sunlight or dark lighting conditions
- 10 pushbuttons for easy screen navigation, system test, lamp test, alarm reset, and horn silencing
- Multicolored LED's for alarm and mode annunciation
- LEDs shall be labeled with removable labels to allow for easy field modification of language changes
- All controller settings shall be programmable through the OID and shall be protected by two password levels
- All features shall be enabled or disabled through the OID, no jumpers or external wires shall be needed or allowed to activate or deactivate a feature
- The system status data shall be displayed on the OID. The displayed items shall include: System pressure, Phase to Phase (AB, BC, AC) voltage, Phase current (A, B, C), System Events and Notifications, Current time and date, Number of starts, Total motor run hours, Displayed countdown timers for: Sequential motor start and motor stop.
- Audible horn with silence feature for silencable alarms
- Lamp test feature
- Foreign languages selectable through the OID
- Microprocessor based logic with real time/date clock capable of running a minimum of 14 days without AC power connected to controller and non-volatile flash memory to

permanently store the continuous pressure log, event log, alarm log and all user changeable set points and system data. Battery backup of any kind not allowed.

- Input and output status LED's to provide visual indication of each discrete input's or output's on/off status
- One RS485 Serial Port
- All wiring terminals on PCB's shall be removable type

Auxiliary alarms

As standard the controller shall include 6 discrete auxiliary inputs, 9 form 'C' auxiliary relay outputs. These auxiliary inputs and outputs are in addition to those mandated by NFPA 20. All auxiliary inputs, outputs, and OID screens shall be field programmable through the OID. This permits a multitude of customizable controller configurations to meet each installations unique needs without adding cost to the controller. The use of jumpers, soldering, or other external components are not allowed.

The user can select any 9 of the following auxiliary alarms that can be programmed and recorded in the event log and annunciated with an OID screen and output relay contact for conditions such as but not limited to:

LOW PUMP ROOM TEMP **RESERVOIR LOW** RESERVOIR EMPTY **RESERVOIR HIGH** FLOW METER ON RELIEF VALVE OPEN LOW SUCTION PRESSURE HIGH PUMP ROOM TEMPERATURE LOW FIREWATER PRESSURE LOW PURGE PRESSURE LOW GEAR OIL PRESSURE HIGH GEAR OIL TEMPERATURE GAS DETECTION **HIGH VIBRATION** EMERGENCY POWER ON PUMP ROOM DOOR OPEN

Data logging

The controller shall have separate data logs for storing system data that is readable through the OID.

Pressure Log: The controller shall have a Pressure log with continuous pressure recording of 30 days of data. The pressure log samples shall be time and date stamped and stored on a removable SD card memory. The pressure log shall be searchable by each sample, by minute, or

by hour. Each days entries shall be stored in a separate file on the SD card. SD memory shall be readable by any PC equipped with an SD memory card reader.

Event Log: The event log shall be capable of storing no less than 3000 events. These events shall include, but is not limited to, any of the following events/alarms:

PUMP RUNNING POWER AVAILABLE PHASE REVERSAL MOTOR OVERLOAD REMOTE START LOCAL START PUMP ON DEMAND SYSTEM FAULT AUTO MODE MANUAL MODE OFF MODE PRESSURE TRANSDUCER FAULT PUMP FAILED TO START LOW INTAKE SHUTDOWN ALARM SUPERVISORY POWER FAILURE LOW PRESSURE AUTO WEEKLY TEST START UNDER FREQUENCY OVER FREQUENCY LOW ZONE / HIGH ZONE CONTACTS HIGH DISCHARGE PRESSURE NO LOAD CONDITION

Each event or alarm recorded in the event log shall have the following data recorded with the event/alarm:

- Time and Date of Event or Alarm
- System Pressure
- Descriptive Text Message of the Event/Alarm
- Motor Running Status
- Phase to Phase Volts
- Phase Amps

The internal logic of the controller shall be capable of operation in a temperature range of 0°C to 50°C and high, non-condensing, humidity levels.

The controller shall be manufactured by Metron.